
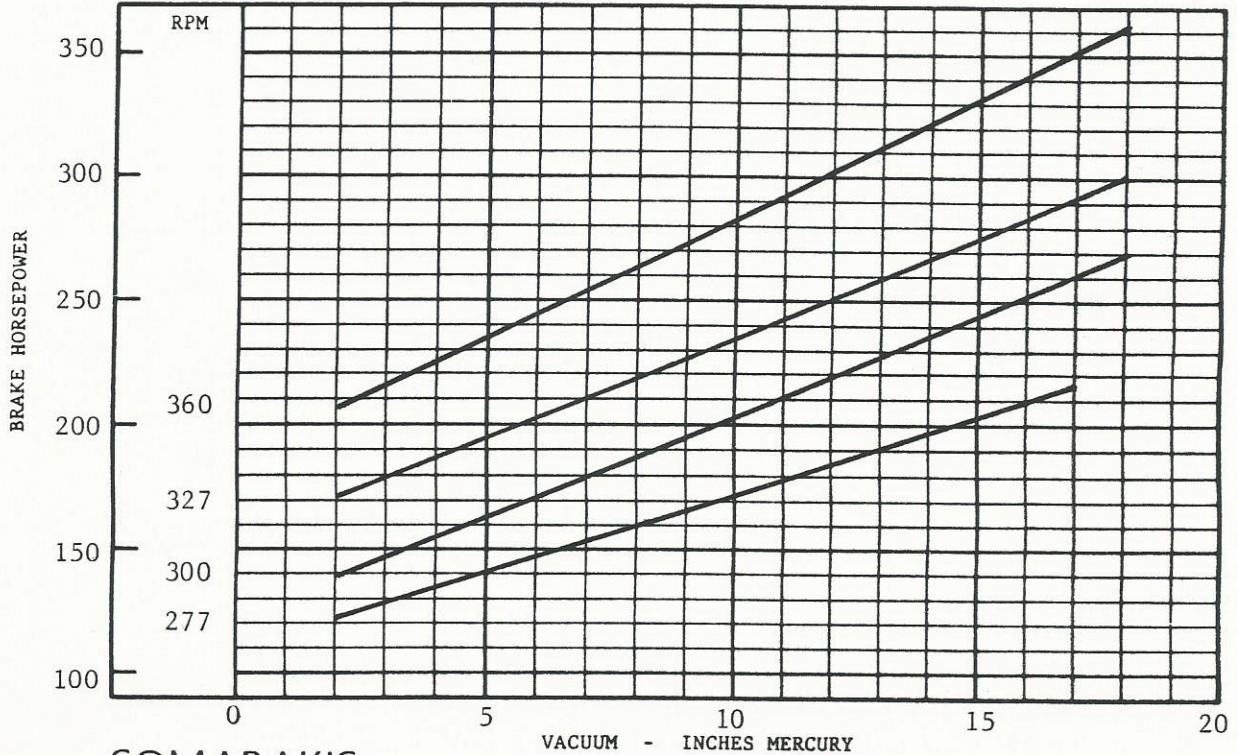


STANDARD PERFORMANCE OF SV VACUUM PUMP: TEST DATES \_\_\_\_\_  
 MODEL NO. SV-4440-1 SERIAL NOS. \_\_\_\_\_  
 30" Hg BAROMETER - 60°F SEAL WATER IN JOB NOS. \_\_\_\_\_

SEAL WATER REQUIREMENTS					
VACUUM - " Hg	5	10	15		
VOLUME - GPM	30	30	40		

PUMP NAMEPLATE	
SPEED - RPM	
VACUUM - " Hg	


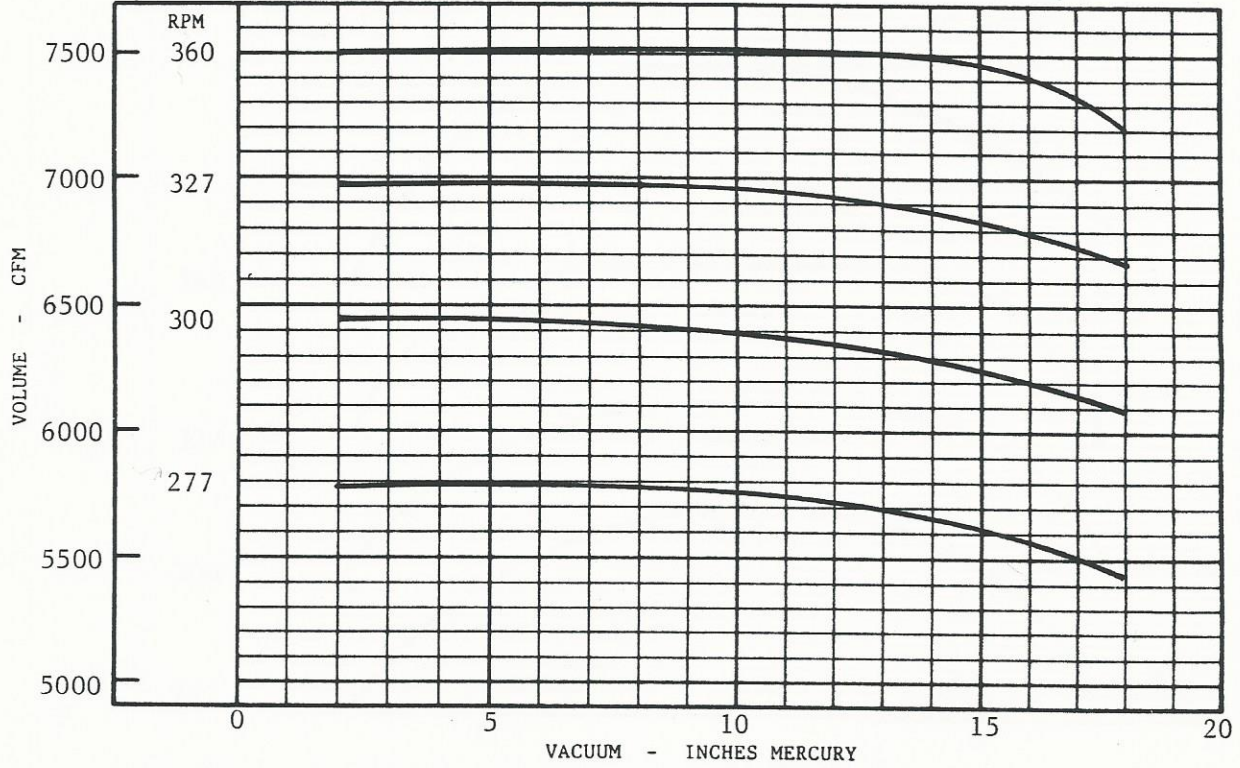


SOMARAKIS

STANDARD PERFORMANCE OF Sv VACUUM PUMP: TEST DATES \_\_\_\_\_  
 MODEL NO. SV-4440-2 SERIAL NOS. \_\_\_\_\_  
 30" Hg BAROMETER - 60°F SEAL WATER IN JOB NOS. \_\_\_\_\_

SEAL WATER REQUIREMENTS						
VACUUM - " Hg	5	10	15	20		
VOLUME - GPM	30	30	40	60		

PUMP NAMEPLATE	
SPEED - RPM	
VACUUM - " Hg	

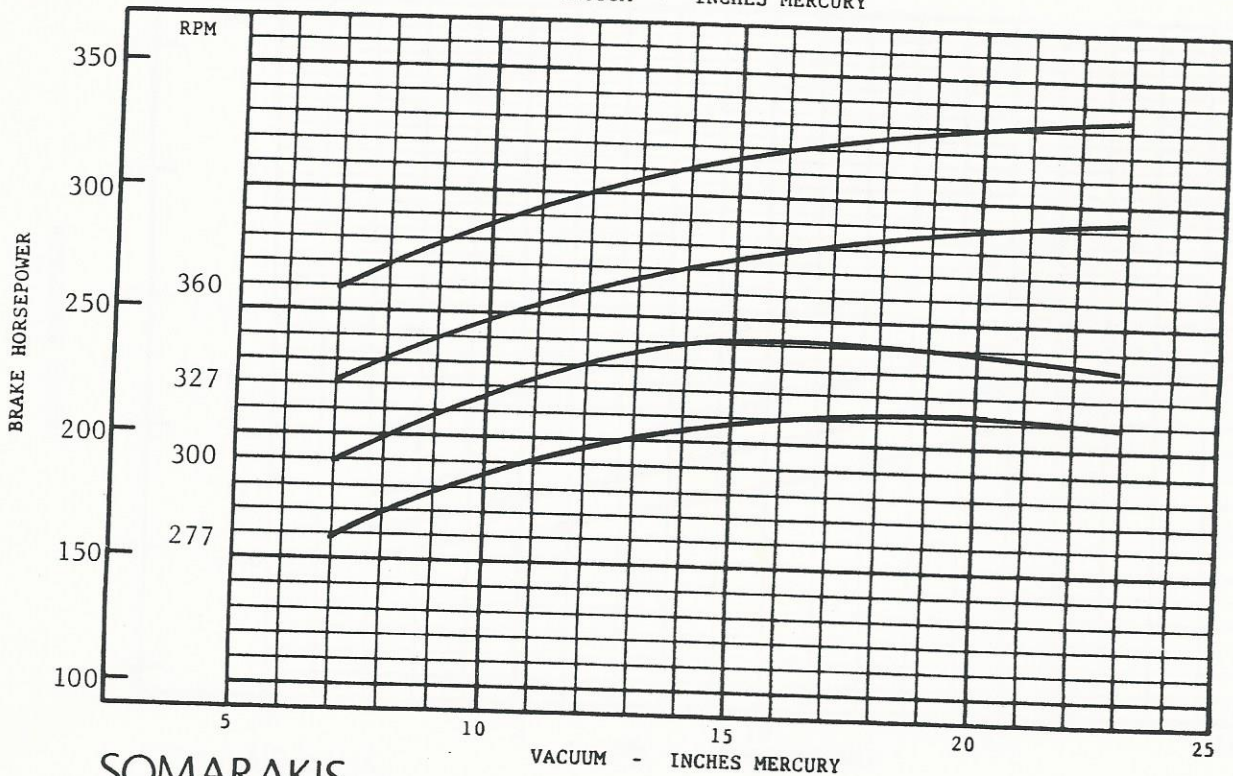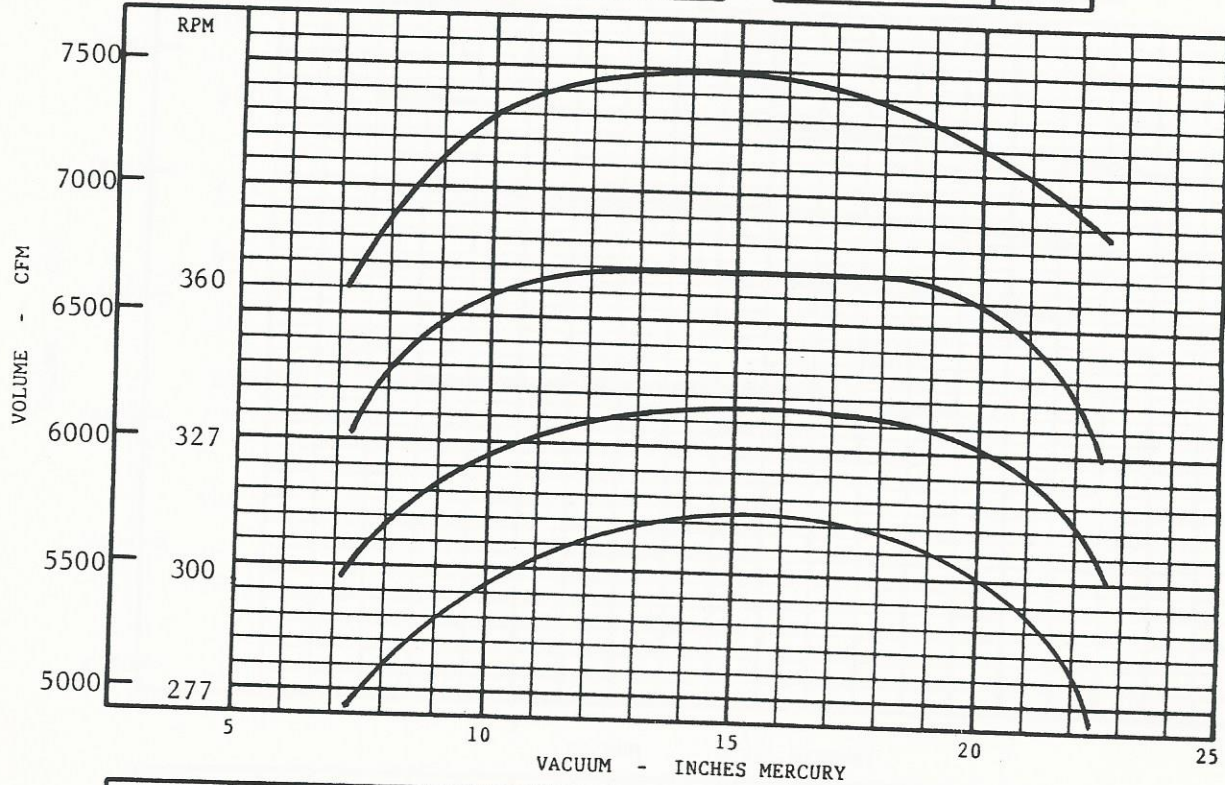

SOMARAKIS